


# Susquehanna Nuclear Energy Guide Notebook

---

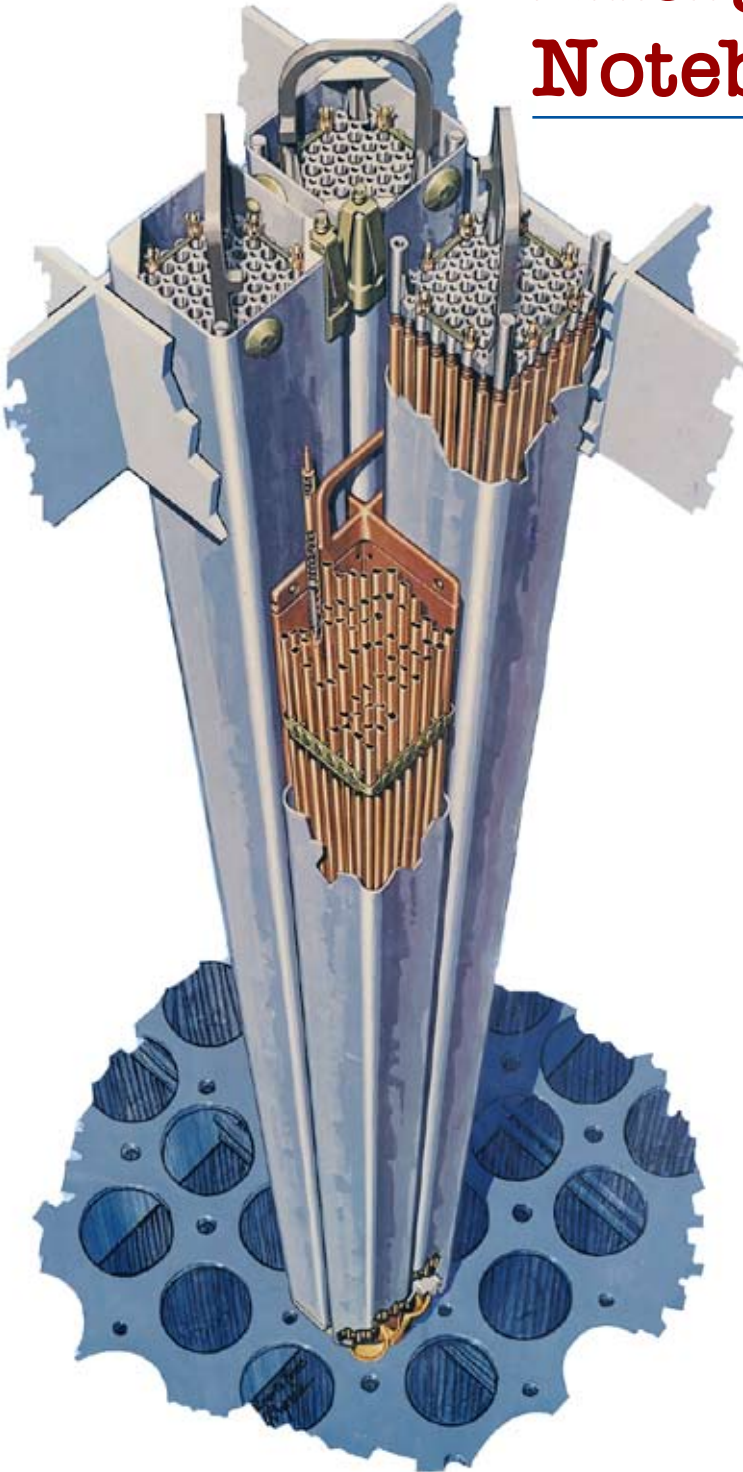

## Introduction

PPL has a responsibility to operate the Susquehanna nuclear power plant safely. At Susquehanna, public health and safety take precedence over all other factors in decisions about plant operations.

This concern for safety is a key element in the plant's design, operating procedures and training programs for plant workers. In addition, PPL has in place a detailed emergency response plan that is tested regularly with the cooperation of municipal, county, state and federal organizations.

PPL also wants the public to be aware of issues and events that affect the plant. The news media is an important conduit for public information.

To that end, PPL has developed this guide to help reporters explain technical nuclear power issues. This primer includes information on the Susquehanna plant's history, design, operations and emergency plan, as well as basics about radiation.

During plant emergencies, PPL representatives will hold periodic news briefings at the Joint Information Center. For telephone numbers and travel directions, please see pages 6-9.

## Table of Contents

Introduction.....	2
Susquehanna Nuclear Plant – At a Glance .....	4
Joint Information Centers .....	6
Susquehanna Energy Information Center .....	6
East Mountain Business Center .....	6
Susquehanna Background .....	10
Plant Construction Timeline.....	10
General Plant Information .....	10
Emergency Preparedness .....	12
Overview .....	12
Public Notification.....	13
Protective Actions.....	14
Emergency Classifications .....	14
How Electricity Is Produced.....	16
Plant Facilities .....	18
Reactor Buildings .....	18
Turbine Building .....	18
Control Structure .....	18
Cooling Towers.....	18
Auxiliary Buildings .....	18
The Reactor.....	19
Vessels .....	19
Fuel .....	19
Control Rods .....	21
Water Circulation .....	22
Spent Fuel.....	23
Safety Systems.....	24
Defense in Depth.....	24
Primary Barriers .....	24
Cooling Water Sources .....	25
Emergency Core Cooling Systems .....	26
Air Filtration System .....	26
Power Supply Sources .....	27
Programs and Procedures .....	27
Personnel .....	27
Radiation .....	28
What Is It? .....	28
Exposure .....	29
Contamination .....	30
Measuring and Detecting Radiation .....	30
Glossary .....	32
Other Sources of Information .....	37

## Susquehanna Nuclear Plant - At a Glance

<b>Ownership</b>	PPL Susquehanna LLC	90 percent
	Allegheny Electric Cooperative Inc.	10 percent
<b>Location</b>	A 2,100-acre site in Salem Township, Luzerne County, about seven miles northeast of Berwick, and about 20 miles south-west of Wilkes-Barre, Pa.	
<b>Capacity</b>	Two generating units of 1,300 megawatts each	
<b>Generators</b>	Speed	1,800 revolutions per minute
	Voltage	24,000 volts
	Cooling	Stator by water Rotor by hydrogen
<b>Turbines</b>	Type	Tandem compound, six flow
	Steam Temperature	540°F (282°C)
	Steam Pressure	960 pounds per square inch (gauge)
	Steam Flow	16,600,000 pounds per hour
<b>Turbine-Generators</b>	Length	208 feet (63 meters)
<b>Transformers</b>	Capacity	1,214,000 kilovolt-amperes
	Voltage Step-Up	Unit 1 – 230,000 volts Unit 2 – 500,000 volts
	Cooling	Oil
<b>Reactors</b>	Type	Boiling water, direct cycle
	Coolant	Water
	Moderator	Water
	Core Coolant Flow Rate	216,000 gallons per minute
	Feedwater Inlet Temperature	400°F (204°C)
	Steam Outlet Temperature	550°F (288°C)
	Coolant Pressure (inlet)	1,075 pounds per square inch
	Steam Capacity	16,600,000 pounds per hour
	Heat Output	13,485,000,000 British thermal units per hour (3,952 mega- watts-thermal)
<b>Fuel Cores</b>	<i>Pellets</i>	
	Material	Uranium dioxide (UO <sub>2</sub> )
	Enrichment	0.71 to 4.95 percent
	Total Weight, Uranium	about 135 metric tons per reactor
	<i>Rods</i>	
	Material	Zircaloy – 2
	Cladding Thickness	0.024 inches
	Outside Diameter	0.396 inches
	Length	about 13.5 feet
	Number	69,524 per reactor

<b>Control Rods</b>	Material	Stainless steel
	Neutron Absorber	Boron carbide and hafnium
	Blade Length	14.4 feet (4.4 meters)
	Blade Width	9.75 inches (24.77 centimeters)
	Number	185 per reactor
<b>Pressure Vessels</b>	Material	Carbon steel lined with stainless steel
	Height	73.5 feet (22.4 meters)
	Weight	750 tons
	Inside Diameter	20.9 feet (6.4 meters)
	Wall Thickness	4 to 9 inches (10 to 23 centimeters)
	Design Temperature	575°F (302.5°C)
<b>Containment</b>	Design Pressure	1,250 pounds per square inch
	Material	Reinforced concrete with steel liner
	Height	161 feet (49.2 meters) above base slab
	Wall Thickness	6.0 feet (1.83 meters)
	Lining	0.25 inch (6.35 millimeters) steel
	Volume	519,450 cubic feet
	Design Pressure	53 pounds per square inch
<b>Condensers</b>	Material	Stainless steel tubing
	Number of Tubes	81,500
	Tubing Length	616 miles (991 kilometers)
	Condensing Surface	880,000 square feet
	Cooling Water Flow	484,000 gallons per minute
	Cooling Range	37°F (21°C)
<b>Water Supply</b>	Water is replaced from the Susquehanna River. Combined with other water needs of the plant, this make-up amounts to about 0.6 percent of the average river flow.	
<b>Schedule</b>	Application for Construction	Permit received April 1, 1971
	Construction Permit issued by Atomic Energy Commission	November 2, 1973
	Commercial Operation	Unit 1 – June 8, 1983 Unit 2 – February 12, 1985
<b>Employment</b>	Permanent Personnel	About 1,100 full-time PPL employees at the plant site and 170 in Allentown, Pa.
<b>Cost</b>	\$4.1 billion	

## Joint Information Centers

PPL uses two joint information centers, depending on the situation, to keep the news media, elected officials and the public informed about incidents of widespread interest concerning the Susquehanna nuclear power plant. PPL news releases will include the location and telephone number of the Joint Information Center in use at the time.

### **Susquehanna Energy Information Center**

**634 Salem Blvd., Berwick, PA 18603**

- Located on U.S. Route 11 about seven miles northeast of Berwick, across the highway from the power plant.
- Would be used for localized events or small-scale emergencies at the plant.
- Phone number: 1-866-832-4474.
- Auditorium can accommodate about 75 people for news briefings; workspace for reporters is available.
- See directions on page 8.

### **East Mountain Business Center (EMBC)**

**1190 E. Mountain Blvd., Wilkes-Barre, PA 18702-7992**

- Located in the Corporate Center at East Mountain Business Park, about 30 minutes from the power plant, just off Route 115 about two miles south of Wilkes-Barre.
- Would be used for any plant event that may attract extensive news media coverage.
- Phone number: 570-831-6300.
- Auditorium can accommodate up to 300 people for news briefings and has sufficient lighting for video, a satellite feed to receive signals from remote locations and a direct sound feed.
- See directions on pages 8 and 9.

### **General**

- Reporters and camera crews arriving at the center should check in with the receptionist at the door and receive a badge for entry into the media workroom and auditorium.
- A chief spokesperson will be designated to provide the timely release of information and to answer your questions during news briefings.

A technical briefer also will be available to explain technical details about plant operations. Media relations support personnel are not authorized to provide interviews.

- During emergencies, PPL's primary responsibility centers on information regarding the status of the plant. The Pennsylvania Emergency Management Agency is responsible for releasing any information regarding public protective measures.
- News material will be hand-carried to the auditorium as soon as it is produced. It also will be available on the PPL Newsroom ([www.pplnewsroom.com](http://www.pplnewsroom.com)) and PPL corporate ([www.pplweb.com](http://www.pplweb.com)) websites.
- At the EMBC, audio splitters are available in the auditorium and connect directly to the sound system, eliminating the need for microphone trees. Television cable access also is available; however, telephone links for direct broadcast are not.

## **Directions to Joint Information Center: Susquehanna Energy Information Center**

---

**From Allentown, Philadelphia and south:** Take Pa. Turnpike Northeast Extension (Interstate 476) to Exit 95. Drive west on Interstate 80 to Exit 256. Turn right from exit ramp onto State Route 93 North. Follow Route 93 to U.S. Route 11 — turn right at the first traffic light after crossing the Susquehanna River. Take Route 11 north; the Information Center is on the right just past the power plant.

**From the Poconos, northern New Jersey, New York City and east:** Take Interstate 80 west to Exit 256. Turn right from exit ramp onto State Route 93 North. Follow Route 93 to U.S. Route 11 — turn right at the first traffic light after crossing the Susquehanna River. Take Route 11 north; the Information Center is on the right just past the power plant.

**From Harrisburg and southwest:** Take Interstate 81 north to Exit 145 (West Hazleton). Turn left from exit ramp onto State Route 93 North. Follow Route 93 to U.S. Route 11 — turn right at the first traffic light after crossing the Susquehanna River. Take U.S. Route 11 north; the Information Center is on the right just past the power plant.

**From Bloomsburg, Williamsport and west:** Take Interstate 80 east to Exit 241B. Follow U.S. Route 11 north for about 10 miles. The Information Center is on the right just past the power plant.

**From Scranton, upstate New York and north:** Take Interstate 81 south to Exit 164, State Route 29. Go north on Route 29 to U.S. Route 11. Go south on Route 11 about 10 miles to the Information Center, which is on the left.

## **Directions to Joint Information Center: East Mountain Business Center**

---

**From the Susquehanna plant/Information Center:** Take U.S. Route 11 north to State Route 29. Go south on Route 29 to Interstate 81. Go north on Interstate 81 to Exit 170A (Bear Creek). Go south on State Route 115 to East Mountain Boulevard and turn left.

**From Allentown, Philadelphia and south:** Take Pa. Turnpike Northeast Extension (Interstate 476) to Exit 105 (Wilkes-Barre). Go north on State Route 115 to East Mountain Boulevard and turn right.


*(continued)*

**From Poconos, northern New Jersey, New York City and east:** Take Interstate 80 west to Pennsylvania Exit 277. Go north on Pa. Turnpike Northeast Extension (Interstate 476) to Exit 105 (Wilkes-Barre). Go north on State Route 115 to East Mountain Boulevard and turn right.

**From Hazleton, Harrisburg, southwest:** Take Interstate 81 north to Exit 170A (Bear Creek). Go south on State Route 115 to East Mountain Boulevard and turn left.

**From Bloomsburg, Williamsport and west:** Take Interstate 80 east to Interstate 81 Exit 260. Go north on Interstate 81 to Exit 170A (Bear Creek). Go south on State Route 115 to East Mountain Boulevard and turn left.

**From Scranton, upstate New York and north:** Take Interstate 81 south to Exit 170A (Bear Creek). Go south on State Route 115 to East Mountain Boulevard and turn left.

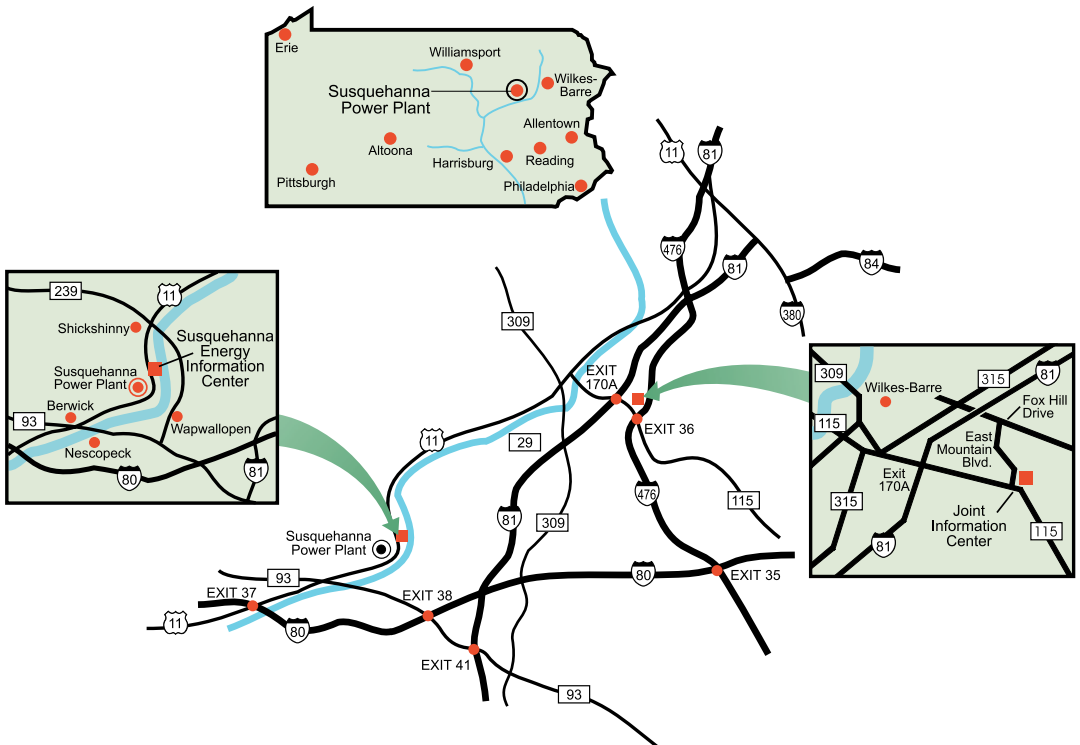

## Susquehanna Background

### Plant Construction Timeline

#### 1970

- PPL announces construction plans for the plant. Coal-fired plants then provided most of PPL's generating capacity.
- The site was chosen for its stable geology, available cooling water from the Susquehanna River, accessible power supply lines to other parts of PPL's service area and convenient highway and rail transportation.

#### 1973

- U.S. Atomic Energy Commission issues construction permit and work begins in November. Bechtel Power Corp. was the primary contractor.
- More than 5,000 people work to design, build and test the plant.

#### 1982

- Unit 1 receives operating license in July and generates its first electricity in November.

#### 1983

- Unit 1 begins commercial service in June.

#### 1984

- Unit 2 receives operating license in March and generates its first electricity in July.

#### 1985

- Unit 2 begins commercial service in February.

### General Plant Information

#### Location

- On a 2,100-acre site in Salem Township, Luzerne County, Pa.
- About seven miles northeast of Berwick, Pa.
- About 20 miles southwest of Wilkes-Barre, Pa.

#### Ownership

- PPL Susquehanna LLC owns 90 percent of the plant and operates it. Allegheny Electric Cooperative Inc. owns the remaining 10 percent.
- PPL Susquehanna LLC is a subsidiary of PPL Generation LLC, which is a subsidiary of PPL Corporation based in Allentown, Pa. PPL Corporation controls or owns about 19,000 megawatts of generating capacity in the United States, sells energy in key U.S. markets, and delivers electricity and natural gas to about 5.2 million customers in the United States and the United Kingdom.

- Allegheny Electric Cooperative, based in Harrisburg, provides power to member cooperatives in Pennsylvania and New Jersey. Allegheny purchased 10 percent of the Susquehanna plant in 1977.

### **Operation**

- Susquehanna has two boiling water reactors made by General Electric Co.
- The splitting, or fissioning, of uranium ( $U^{235}$ ) atoms heats water as it passes by the fuel in the reactor. The heated water turns to steam, which drives the turbine-generators to produce electricity.
- Each unit has a capacity of 1,300 megawatts of electricity; the plant's full output is about 62.4 million kilowatt-hours a day.

### **Training**

- Susquehanna has an on-site training center whose staff instructs personnel using a curriculum fully accredited by the National Academy for Nuclear Training.
- Control room crews spend one week out of six training either in the classroom or on an advanced control room simulator.
- Licensed nuclear reactor operators are requalified every year. Maintenance and technical support personnel complete extensive training for certification in their specialties.

### **Employment**

- During normal operation, about 1,100 full-time employees work at the plant in operations, maintenance, engineering and technical support positions.
- About 2,000 people work at the plant during refueling outages. Each unit is shut down for refueling every 24 months, during which time about one-third of the uranium fuel in the reactor is replaced and other planned maintenance and inspection tasks are completed.

# Emergency Preparedness

## Overview


Susquehanna has a large emergency response network consisting of 27 municipalities, county and state governments, school districts, hospitals, fire companies, ambulance and emergency medical services, and federal agencies.

The Nuclear Regulatory Commission has reviewed and approved Susquehanna's emergency plan.

The level of response to an event depends on the potential threat to public health and safety. In any emergency at Susquehanna, PPL has three objectives:

1. Take any necessary actions to end the emergency.
2. Activate the emergency plan to reduce any potential risk to public health and safety.
3. Keep the public informed about events at the plant.

## 10-Mile EPZ

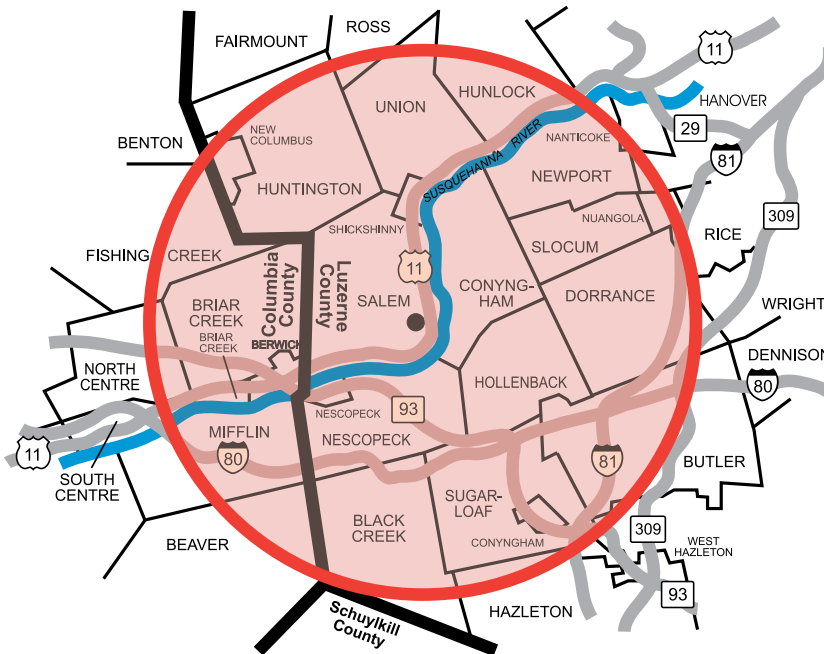

## Public Notification

PPL maintains a network of 76 sirens in the communities around Susquehanna. PPL provided the sirens for use by Luzerne and Columbia county officials in any emergency, nuclear or non-nuclear.

- Luzerne and Columbia are called “risk” counties because they include areas within 10 miles of the plant where residents may be ordered to evacuate in a serious emergency.
- If an emergency requires public action, county officials will sound the sirens in a steady tone for three to five minutes. When area residents hear a steady siren tone, they should turn on a radio or television and tune to an Emergency Alert System station for official information and instructions.
- Some of the sirens are shared with local fire companies. When used for fire company purposes, the sirens sound in a varying tone and there is no need for action by area residents.
- PPL and the counties test the sirens monthly; PPL is responsible for maintaining the sirens.
- In addition to sirens, police, firefighters and volunteers in some areas will drive around with mobile public address systems. For people with special needs, volunteers will go door to door to provide help, information and instructions.
- The Emergency Alert System for Luzerne and Columbia counties includes 25 radio stations and two television stations.

### Local Emergency Alert System (EAS)

#### Columbia County

WCNR-AM 930  
 WJMW-AM 550  
 WFYY-FM 106.5  
 WKAB-FM 103.5  
 WKXP-FM 95.9  
 WQKX-FM 94.1  
 WBRE Ch. 28

#### Luzerne County

WAZL-AM 1490      WWFH-FM 103.1  
 WBAX-AM 1240      WDLS-FM 93.7  
 WILK-AM 980      WSFX-FM 89.1  
 WILP-AM 1300      WRKC-FM 88.5  
 WKQV-AM1550      WRGN-FM 88.1  
 WNAK-AM 730      WMGS-FM 92.9  
 WYCK-AM 1340      WQFM-FM 92.1  
 WZMT-FM 97.9      WWSH-FM 102.3  
 WKRZ-FM 98.5      WBRE Ch. 28  
 WCLH-FM 90.7      WYLN Ch. 35  
 WBHT-FM 97.7

## **Protective Actions**

If releases of radiation from the plant were at levels high enough to affect public health and safety, the governor of Pennsylvania would recommend that people who live near the plant take protective action. In Pennsylvania, only the governor has the authority to order protective actions depending on actual or expected plant conditions. The two forms of protective action are sheltering and evacuation.

### **Sheltering**

- Stay indoors until official word is given through the Emergency Alert System that it is safe to go outside.
- Close all doors, windows and vents, and turn off fans and air conditioners that draw in air from outside.
- If coming in from outside, wash thoroughly, especially before eating.

### **Evacuation**

- Leave the area and go to temporary shelter facilities outside the 10-mile Emergency Planning Zone around the plant.
- Generally applies to the 70,000 people living within 10 miles of the plant.
- Emergency Planning Zone residents receive information yearly that lists evacuation routes and temporary shelters for an evacuation.
- Schoolchildren would be taken to host schools outside the 10-mile area where their families can pick them up. Plans are in place to evacuate hospital and nursing home patients and others with special transportation needs.
- Special information is available to area farmers to help them care for animals during an emergency. Farmers living within 10 miles of the plant have been advised to keep a supply of covered feed for use if needed.

## **Emergency Classifications**

The Nuclear Regulatory Commission has established four categories for nuclear power plant emergencies. A plant operations manager has 15 minutes to classify the event into one of these four categories:

### **Unusual Event**

- A minor problem has occurred at the plant.
- No action by the general public is required.
- PPL notifies public officials, emergency management, news media and elected officials.

### **Alert**

- A problem has occurred that may affect plant safety and has the potential to become more serious.
- No action by the general public is required.
- PPL notifies public officials and emergency management agencies, news media and elected officials. Emergency management agencies activate their emergency centers and coordinate support services.

### **Site Area Emergency**

- A serious problem has occurred that has affected or may affect major plant safety systems.
- Radiation levels are not expected to be above federal limits at the site boundary.
- PPL notifies public officials and emergency management agencies, news media and elected officials.
- Local, county and state emergency centers are fully operational.
- Per PPL policy, employees who do not have necessary emergency or operation functions are asked to leave the plant because it is easier to manage an emergency with a smaller group of people whose only responsibility is returning the plant to normal operations.

### **General Emergency**

- A problem has occurred — or is imminent — involving serious damage at the plant and failure of plant safety systems.
- Radiation releases are expected to exceed federal limits beyond plant property.
- Plant conditions may threaten public health and safety. If the governor of Pennsylvania decides protective action is necessary, county officials will sound sirens as a signal for people to turn on a radio or television and tune to an Emergency Alert System station for information and instructions.
- PPL notifies public officials and emergency management agencies, news media and elected officials.
- Local, county, state and federal emergency centers are fully operational and take any action needed to protect public health and safety.
- Per PPL policy, employees who do not have necessary emergency or operation functions are asked to leave the plant because it is easier to manage an emergency with a smaller group of people whose only responsibility is returning the plant to normal operations.


# How Electricity Is Produced

## Energy

- Susquehanna produces electricity by boiling water to create steam that turns a turbine-generator.
- Nuclear fuel does not burn like fossil fuels (coal, oil and natural gas) to produce electricity. Instead, heat produced by the energy released during nuclear fission, the process of splitting the nucleus of a uranium atom, causes water in the reactor to boil.
- At full power, each reactor makes about 16.6 million pounds of steam an hour.
- Steam passes through four turbines, each with hundreds of fan-like blades on rotating parts.
- Turbines turn a main generator at 1,800 revolutions per minute to produce electricity at 24,000 volts.
- Each unit has main transformers to increase the voltage to 230,000 volts on Unit 1 and to 500,000 volts on Unit 2 for transmission to customers.

## Cooling

- After steam gives up energy in the turbine-generator, it enters the condenser, an enclosed tank with more than 600 miles of stainless steel tubes.
- Nearly 484,000 gallons of cooling water flow through those tubes every minute.
- The tubes keep the steam, containing some radioactive gases, separate from the cooling water.
- The steam comes in contact with the tubes, cools and condenses back into water.

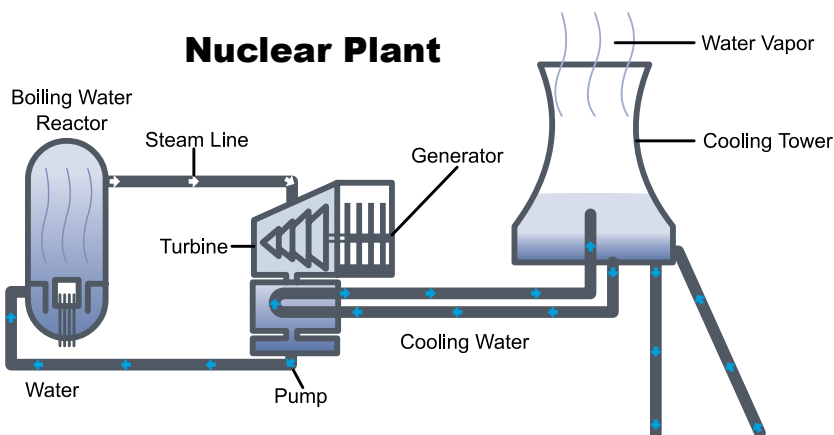

- This water is collected, purified by a series of filters that trap mineral particles suspended in the water (the condensate demineralizer system), heated and pumped back into the reactor to begin the cycle again.

## **Water**

- As steam condenses, the temperature of the water used for cooling increases by about 30° F.
- After passing through the condenser, this nonradioactive cooling water is pumped to the cooling towers, where it trickles down over a series of baffles.
- As the water falls, it is cooled by evaporation.
- At full power, each cooling tower evaporates about 10,000 gallons per minute.
- Heat and water vapor rise from the cooling towers.
- Cooled water collects at the tower base and is pumped back to the condenser.
- Water from the Susquehanna River makes up for cooling water lost to evaporation.
- At full power, the plant uses about 20,000 gallons per minute from the river, 0.6 percent of the average river's flow annually.

## Plant Facilities

### Reactor Buildings

- Two reinforced concrete and steel buildings, each about 200 feet tall, house the plant's nuclear reactors, as well as most of the equipment associated with plant emergency safety systems.
- Within each building, and surrounding each reactor, is a specially designed containment structure 160 feet tall with thick, steel-lined, reinforced concrete walls.

### Turbine Building

- Two turbine-generators produce the electricity and are located in a 125-foot-tall building adjacent to the reactor building.
- Each turbine-generator assembly is 208 feet long, weighs about 650 tons and is mounted on a reinforced concrete pedestal more than 50 feet tall.

### Control Structure

- Between the reactor and turbine buildings, but separate from both, is the 134-foot-tall control structure.
- This building contains the control room for both units and plant computer equipment.
- It has its own ventilation system that allows operators to remain in the control room even in the unlikely event that other areas of the plant must be evacuated.

### Cooling Towers

- The two cooling towers are each 540 feet tall.
- Cooling water used in the plant flows down over a series of baffles, losing heat by evaporation as it falls.
- Water collects at the bottom of each tower for reuse in the plant. Nonradioactive water vapor rises from the towers.
- Cooling towers are not unique to nuclear plants; they are used at generating plants to conserve water and to limit thermal pollution from warm-water discharges to the river.

### Auxiliary Buildings

- Other facilities on-site provide office, storage and maintenance shop space.

# The Reactor


## Vessels

- Each of Susquehanna's reactor vessels is a 750-ton cylinder about 21 feet in diameter standing more than 73 feet tall.
- The walls are made of carbon steel lined with stainless steel and are 4 to 9 inches thick.
- The reactor vessel contains about 130,000 gallons of water.
- The water serves three functions:
  1. It boils to become steam that drives the turbine-generator.
  2. It cools the reactor fuel to prevent overheating or melting.
  3. It moderates the reaction by slowing neutrons released in the fission process to make it more likely that those neutrons will split other atoms.
- Because of the importance of water to plant safety, Susquehanna has multiple backup safety systems, which can be operated manually or automatically, to keep the fuel covered with water.
- When the reactor is operating, water in the vessel is kept under pressure of about 1,000 pounds per square inch and at a temperature of 540°F.

## Fuel

### Susquehanna Plant Statistics


- Powering each reactor is about 135 metric tons of enriched uranium dioxide in the form of ceramic pellets.
- Each reactor is fueled by more than 30 million of these pellets, which are about the size of a standard pencil eraser.
- A single pellet can produce more energy than 1,000 pounds of coal or 100 gallons of gasoline.
- Fuel pellets are stacked 12.5 feet high inside rods that are about 13.5 feet long.
- The rods are made of a special zirconium metal alloy and are arranged in assemblies. This metal tubing surrounding the fuel also is called cladding.

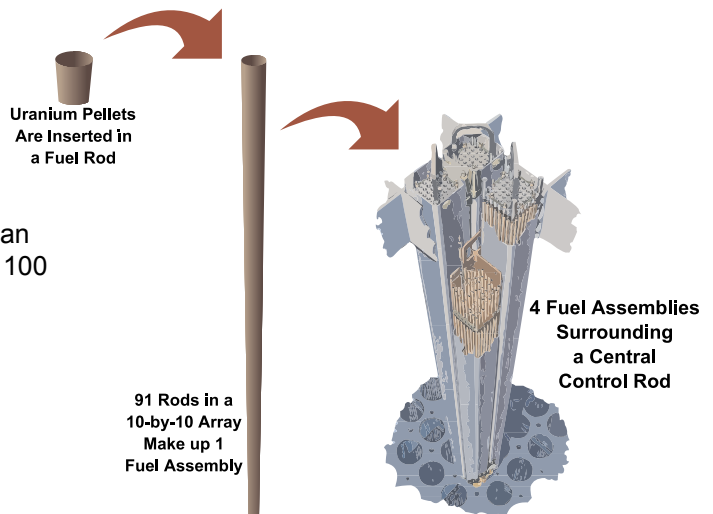

- Each assembly is made up of 91 rods, which are placed in a 10-by-10 array with a water channel in the center equal to a three-by-three array. Fuel assemblies also may be called fuel bundles.
- The reactor core contains 764 of these fuel assemblies.


### General Information

- The energy results from fission, the splitting of atoms into smaller parts. When atoms split, they give off energy in the form of heat.
- Uranium in nature consists primarily of two forms:  $U^{238}$ , which is the form of most uranium, and  $U^{235}$ .
- $U^{235}$  readily reacts with neutrons — particles from the nucleus of an atom that have no electrical charge — and splits into two new atoms.
- As the uranium splits, it gives off other neutrons, which strike other  $U^{235}$  atoms, causing them to split. The continuous splitting of  $U^{235}$  atoms is called a chain reaction.
- The concentration of  $U^{235}$  in naturally occurring uranium is very low — less than 1 percent. For that reason, “light-water reactors” such as Susquehanna do not use raw uranium. Power plant fuel is enriched to increase its content of fissionable atoms to about 5 percent.
- Nuclear weapons fuel, by contrast, is enriched to contain more than 90 percent fissionable material.
- Low enrichment and reactor design make it impossible for nuclear power plant fuel to explode like a bomb.

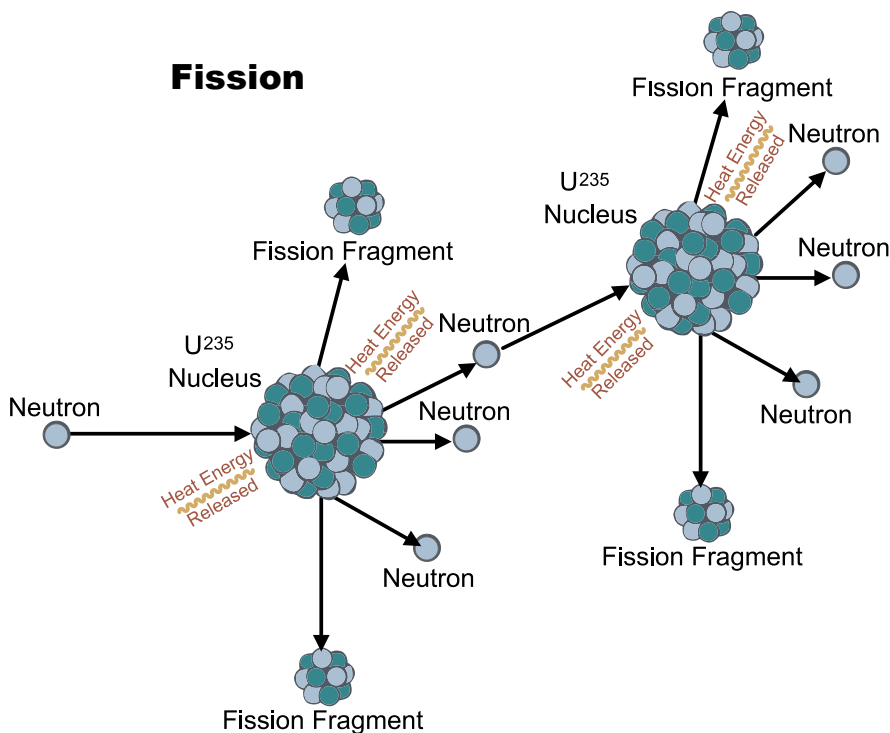

## Control Rods

- Plant operators control the nuclear reaction by the use of rods that insert between the fuel assemblies in the reactor.
- These control rods are made of stainless steel and are filled with boron carbide and hafnium substances that absorb neutrons and prevent them from splitting other uranium atoms.
- Control rods are the same length as fuel rods.
- Each Susquehanna reactor has 185 control rods that insert from the bottom of the reactor.
- By withdrawing or inserting control rods, plant operators can speed up or slow down the nuclear reaction. As control rods are withdrawn from the reactor, the number of atoms splitting increases and the reaction speeds up. As control rods are inserted, the number of atoms splitting decreases and the reaction slows down.
- Operators can shut down the plant in seconds by fully inserting all the control rods at once.
- Under some conditions, control rods will insert automatically to shut down the plant. This type of rapid shutdown is called a “scram.”

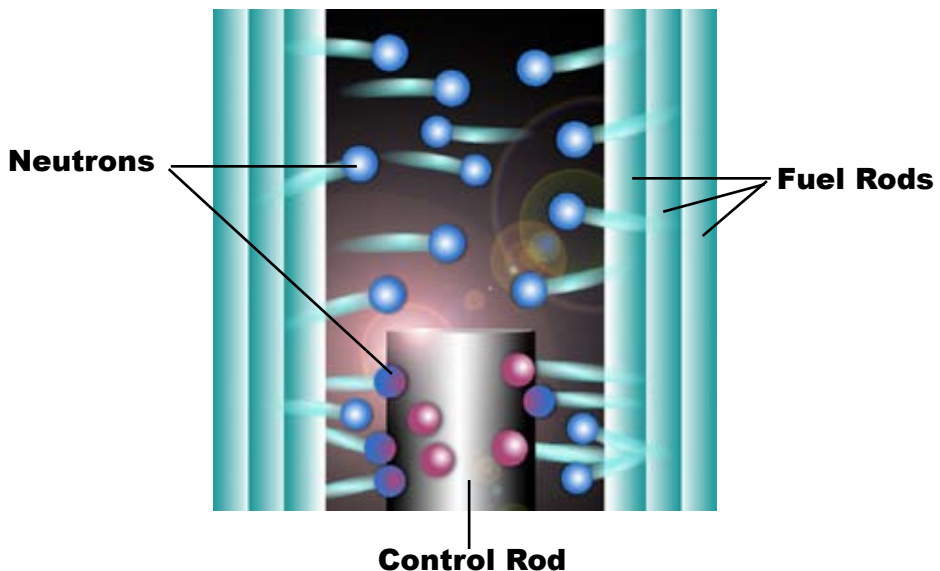

## **Water Circulation**

Water circulation is important to the operation of the Susquehanna units. Water is recycled continuously through the system. It boils to steam in the reactor, then is changed back to water in the condenser to be pumped back into the reactor.

Recirculation of water within the reactor increases the efficiency of the steam-making process and allows plant operators to safely get the maximum amount of power from each generating unit.

Key components of the water circulation system include:

### **Feedwater System**

- Three large pumps, each capable of moving 17,000 gallons a minute, supply water to the reactor vessel.
- Before the water enters the reactor, a series of heaters brings it to the proper temperature.
- All three feedwater pumps must be operating for a unit to run at full power; a unit can continue to operate with one or two feedwater pumps, but at reduced power levels.

### **Recirculation System**

- Two pumps provide continuous recirculation of water within each reactor.
- Recirculation increases the flow of water through the reactor core, allowing the reactor to produce more steam; more steam means the generating unit can produce more electricity.
- This system draws water out of the reactor and forces it to flow back through the core.
- Each recirculation pump moves about 45,000 gallons of water per minute.

## Spent Fuel

Eventually, nuclear fuel loses enough of its energy that it must be replaced. The Susquehanna plant schedules refueling outages for each unit every 24 months. During those outages, typically scheduled in the spring when demand for electricity is lowest, about one-third of the fuel is replaced.

- Fuel assemblies spend about four to six years in the reactor.
- Used fuel pellets in the assemblies being removed from the reactor contain radioactive waste byproducts of the fission process.
- Susquehanna has facilities to store the used fuel safely until the federal government develops a disposal facility. The Department of Energy is responsible for disposal of nuclear power plant fuel.
- Water in the storage pools serves two purposes:
  1. It cools spent fuel that has recently been removed from the reactor and still produces heat.
  2. It provides an effective barrier that shields people from radiation.
- Over time, the amount of heat given off by spent fuel decreases.
- After five years, water is no longer needed for heat removal but continues to serve as an effective radiation barrier.
- Susquehanna's spent fuel pools have cooling and cleanup systems to keep water temperature below 125°F and to filter impurities from the water.

## Dry Spent Fuel Storage

Susquehanna's modular dry fuel storage area is where the plant stores its oldest spent fuel on an interim basis until the federal Department of Energy is ready to remove it. The Nuclear Regulatory Commission allows spent fuel that is at least 5 years old to be stored in dry containers inside concrete modules. This modular system can be expanded as needed.

### Defense in Depth

The design of Susquehanna, and all nuclear plants in the United States, is based on a “defense-in-depth” concept, which refers to the multiple layers of protection for public health and safety.

The design includes imposing concrete and steel structures and redundant safety systems. At the center are three features called “barriers” designed to keep radiation within the plant and prevent or limit its release. Complementing the physical barriers are carefully developed work procedures and extensively trained personnel to ensure consistency and safety.

#### Primary Barriers

**Fuel Cladding:** Fuel is formed into ceramic pellets that are then placed inside long tubes, called fuel cladding, made of a special metal alloy.


#### Reactor Cooling

**System:** The reactor vessel, which has steel walls 4 to 9 inches thick, and its associated piping.

#### Primary Containment:

Surrounding the reactor and its associated piping is a 160-foot-tall structure with 6-foot-thick, reinforced concrete walls lined with a quarter inch of steel. The walls have 120 miles of 2-inch-thick steel reinforcing rods.

### Cutaway of Susquehanna Unit 1 Containment Structure

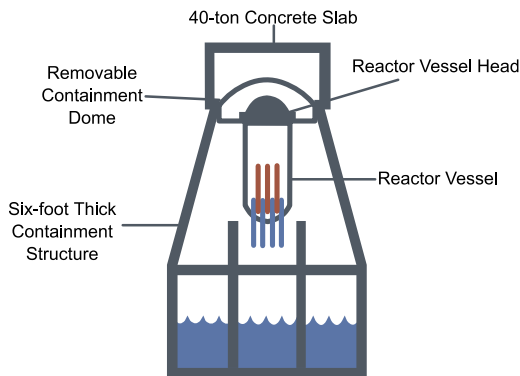

#### Other Design Safety Features

- The primary containment is enclosed by the reactor building, often referred to as secondary containment. The reactor building’s air pressure is kept slightly lower than outside air pressure to protect against radioactive gases escaping the building. The building also has systems that filter out radioactive materials before they are released to the air.
- Where pipes, electrical conduits and air lines pass through the containment structure walls, leak-tight seals keep radioactive material from escaping.

- Pipes that pass through the containment structure walls typically have two sets of valves, one set inside containment and one set outside of it. Either set can seal off the release of radioactivity.
- The reactor itself is self-regulating; the nuclear reaction slows as the water surrounding it gets hotter.
- Water in the reactor removes heat and captures radioactive byproducts that may escape the fuel.
- The plant has multiple levels of safety systems, all of which can operate manually or automatically.

## **Cooling Water Sources**

When atoms split in a nuclear power reactor, they produce heat. Even when the reactor is shut down, the fuel continues to give off heat. Without water, the core would become hot enough to melt the fuel pellets.

Susquehanna has multiple safety systems to ensure that an adequate supply of water covers the fuel at all times. Water for these safety systems comes from a variety of sources:

### **Condensate Storage**

- Two tanks, each with a capacity of 300,000 gallons, hold a reserve supply of reactor water for makeup needs during normal operation, refueling or emergencies.
- In each tank, 135,000 gallons is reserved specifically for emergency core cooling systems. These systems can use all of the water in the tanks if necessary.

### **Suppression Pool**

- Located in the containment structure below the reactor, this pool is 23 feet deep and contains nearly 1 million gallons of water.
- It is a main water supply source for the plant's emergency core cooling systems.

### **Spray Pond**

- This 8-acre, man-made pond located on plant property contains 25 million gallons of water for cooling during normal plant operations and emergencies.
- Water level in the pond is maintained by adding water from the Susquehanna River as needed.

### **Reactor Core Isolation Cooling (RCIC)**

- This system provides make-up water to the reactor vessel when it is shut down, but still pressurized.

## **Emergency Core Cooling Systems (ECCS)**

Susquehanna has a series of independent emergency core cooling systems to maintain water level in the reactor if normal plant cooling systems fail. The systems come on automatically if they sense a reactor water leak. Plant operators also may start them manually.

Some of the systems work when the reactor is at normal operating pressure. Other systems work when the pressure is low.

### **High Pressure Coolant Injection (HPCI)**

- Can add about 5,000 gallons of water per minute.
- Gets the emergency water to the reactor through pipes that feed water to the reactor during normal operation.

### **Automatic Depressurization System (ADS)**

- Uses six safety relief valves on the plant's main steam supply system to reduce pressure quickly inside the reactor.
- Allows low-pressure cooling systems to operate and flood the reactor.

### **Core Spray (CS)**

- Low-pressure system that sprays water directly onto the fuel through nozzles located above the fuel.
- Core spray has two independent systems; each can spray about 6,000 gallons of water a minute.

### **Low Pressure Coolant Injection (LPCI)**

- High-flow system that can pump 42,600 gallons of water a minute into the reactor using pipes that serve the recirculation system during normal operation.

## **Air Filtration System**

Standby gas treatment is an air filtration system used to minimize the effect of airborne radiation releases during an emergency at the Susquehanna plant. The system has several functions:

- Helps keep air pressure inside the reactor building slightly lower than outside air pressure to prevent an uncontrolled, unfiltered release of radioactive material.
- Removes 99.9 percent of the radioactive iodine through a series of activated charcoal bed filters.
- Removes 99.9 percent of the radioactive particulate matter through filters.
- Forces chemically inert radioactive gases through a long ventilation route before leaving the plant, during which time these gases lose much of their radioactivity.

Emissions from the standby gas treatment system go through a vent on the reactor building roof. The vent is monitored continuously by sensitive radiation detection equipment.

Computers analyze monitor data and weather conditions to determine the size and direction of a release. That information helps public officials decide whether to recommend that people take protective action in the unlikely event of a nuclear emergency.

## **Power Supply Sources**

Susquehanna has several independent power sources that supply electricity to plant systems.

### **Power Lines**

- Plant safety systems get electricity from two independent power lines in PPL Electric Utilities' power supply system, which serve as backups to each other.
- The two lines feed separate power transformers.
- Either can provide enough power to meet plant needs.

### **Diesel Generators**

- If both power supply lines fail, the plant has five diesel generators as backups.
- The diesel generators come on automatically to provide power within 10 seconds of power supply loss.
- The plant must have four generators available to operate when either unit is in service.
- The fifth serves as a spare to replace any of the others.
- Susquehanna keeps enough diesel fuel at the plant to run the generators for 30 days.

## **Programs and Procedures**

- A detailed emergency plan is in place to protect the public in the unlikely event of a serious accident. The plan has the support of local, county, state and federal governments, and is tested several times a year.
- Detailed work procedures are used for every job to ensure consistency in how things are done and to provide a proven set of safe work guidelines.
- Procedures are reviewed regularly and revised as needed.
- Work procedures are designed with safety as the first priority.

## **Personnel**

- Susquehanna has training programs in 11 separate disciplines for plant employees.
- Training programs are fully accredited by the National Academy for Nuclear Training.
- Every control room employee trains one week out of six either in the classroom or on an advanced simulator.
- Licensed plant operators requalify for their licenses yearly.
- Many maintenance and technical support employees receive certification in their areas of expertise.

# Radiation

## What Is It?


Radiation is energy in the form of particles or waves, such as light, heat, microwaves and radio waves. These “non-ionizing” forms of radiation do not have enough energy to change the structure of atoms. In nature, atoms of most elements are stable; they won’t change on their own.

Natural and man-made ionizing radiation, however, has enough energy to change the structure of atoms. Radioactive atoms are unstable. To reach a stable state, they give off their excess energy through a natural process known as “decay.”

The main types of radiation emitted as byproducts of nuclear power generation are:

- Alpha particles — The heaviest and least penetrating form of radiation, they can be stopped by a sheet of paper.
- Beta particles — Smaller and more penetrating, they can be stopped by a block of wood or thin sheet of metal.
- Gamma rays — The most penetrating form of radiation, it takes a dense material such as lead or several feet of concrete to stop these highly energetic waves.

Ionizing radiation may damage the cells of living things by changing the structure of their molecules. Exposure to very large amounts of radiation in a short period of time can cause immediate health problems.

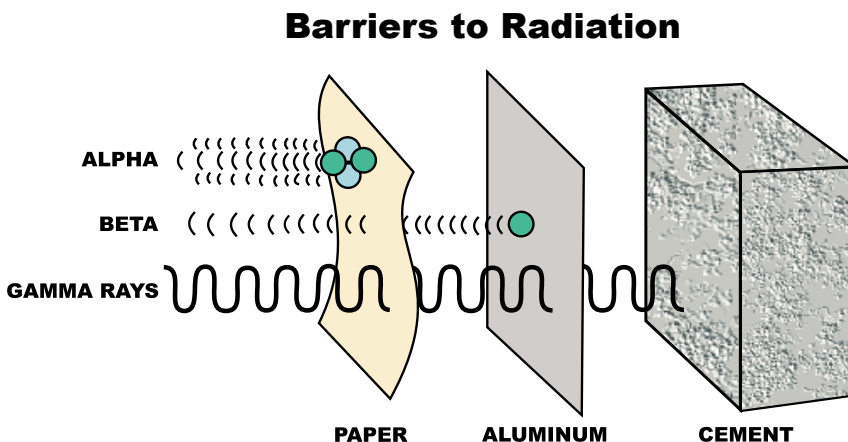


Source: A Basic Guide to Nuclear Power, Edison Electric Institute

## Exposure

Radiation is a natural part of the environment. It is in the air we breathe, the water we drink and the food we eat. The human body is naturally radioactive.

Exposure to radiation is measured in units called millirem. The government sets radiological protection standards based on millirem received over a specified period of time.

- People living in the United States are exposed to an average of about 360 millirem a year. Natural sources account for about 82 percent of the total annual exposure.
- About 200 millirem of exposure is due to naturally occurring radon gas in the air that seeps up from the ground.
- Other natural sources of radiation exposure are the human body, rocks and soil, and cosmic radiation from outer space.
- Man-made radiation sources account for about 18 percent of a person's total annual exposure (about 60 millirem) and come from diagnostic X-rays and other medical procedures.
- During normal operations, the Susquehanna plant releases minute quantities of radiation to the air through filtered ventilation systems and occasionally into the Susquehanna River. These releases are carefully controlled and are monitored continuously to stay well below the strict federal limits.
- Extensive field monitoring has shown essentially no effect on the environment from normal Susquehanna operations.
- The maximum amount of radiation a plant area resident receives is less than one-tenth of 1 millirem a year; most people are exposed to lesser amounts. One-tenth of 1 millirem is 100 times less than the 10 millirem a person would receive from a single dental X-ray.
- Federal regulations limit the exposure for nuclear power plant workers to 5,000 millirem a year.
- Because of strict radiation controls and work procedures at Susquehanna, the average annual exposure for plant workers was 136 millirem in 2009.

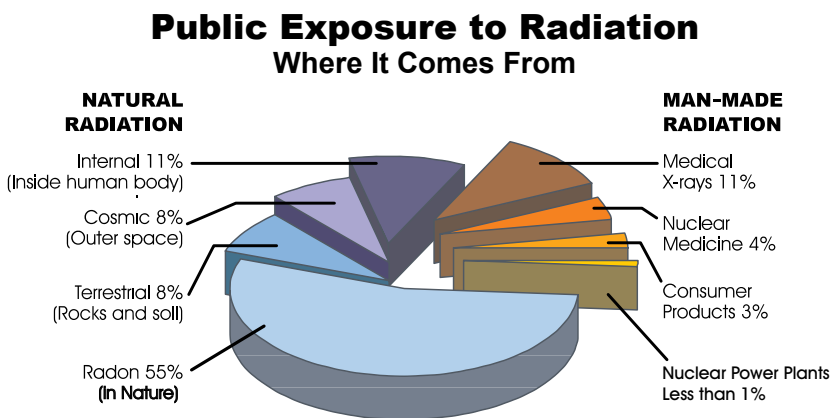

Source: *Understanding Radiation*, Nuclear Energy Institute

- The onset of symptoms associated with radiation sickness begins at a single dose of about 100,000 millirem.
- A single dose of 400,000 millirem or more would be fatal within 30 days to 50 percent of the people exposed.

## **Contamination**


- Contamination occurs when radioactive material is deposited on nonradioactive surfaces. Inside a nuclear power plant, tools, filters and other plant components routinely become contaminated through contact with radioactive materials.
- Plant workers wear special protective clothing and equipment to protect against contamination.
- Access controls are in place at the plant where there are radiological hazards.
- Despite these measures, radioactive material may get on plant workers' clothing or skin. Monitors located throughout the plant detect radioactive contamination; employees pass through them when entering or leaving various work areas and when leaving the plant.
- Radioactive contamination usually is removed from clothing or skin by washing with soap and water at the plant.
- If an injured plant worker is contaminated and needs immediate medical treatment, nearby Berwick Hospital has facilities to prevent the spread of radioactive material while hospital staff treat the injured worker.

## **Measuring and Detecting Radiation**

- The quantity of radioactive material is measured via the number of atoms decaying per second.
- It is possible to detect a single atom decaying.
- The unit of measure for radioactive material is the Curie. One Curie is equivalent to 37 billion atoms decaying per second (the rate of radioactive decay for one gram of radium).
- Susquehanna has a series of monitors inside and outside to detect and measure any radiation released. The state government also maintains radiation monitors in areas around the plant.
- PPL conducts extensive environmental monitoring around the plant, collecting about 850 samples a year at 35 locations. Additionally direct radiation from plant operations is measured at 58 locations and is evaluated quarterly.
- Outside laboratories analyze the environmental samples (air, water, river sediment, vegetation, soil, fish and milk) for radiation.
- In the event of a plant emergency, mobile teams of trained people would measure and track radioactive material releases and identify contaminated areas inside and outside the plant.
- The information they provide would supplement stationary monitors and help determine whether the public needs to take protective action, such as sheltering or evacuation.

# Typical Radiation Exposure

Millirem Annually per Individual  
Average per Activity

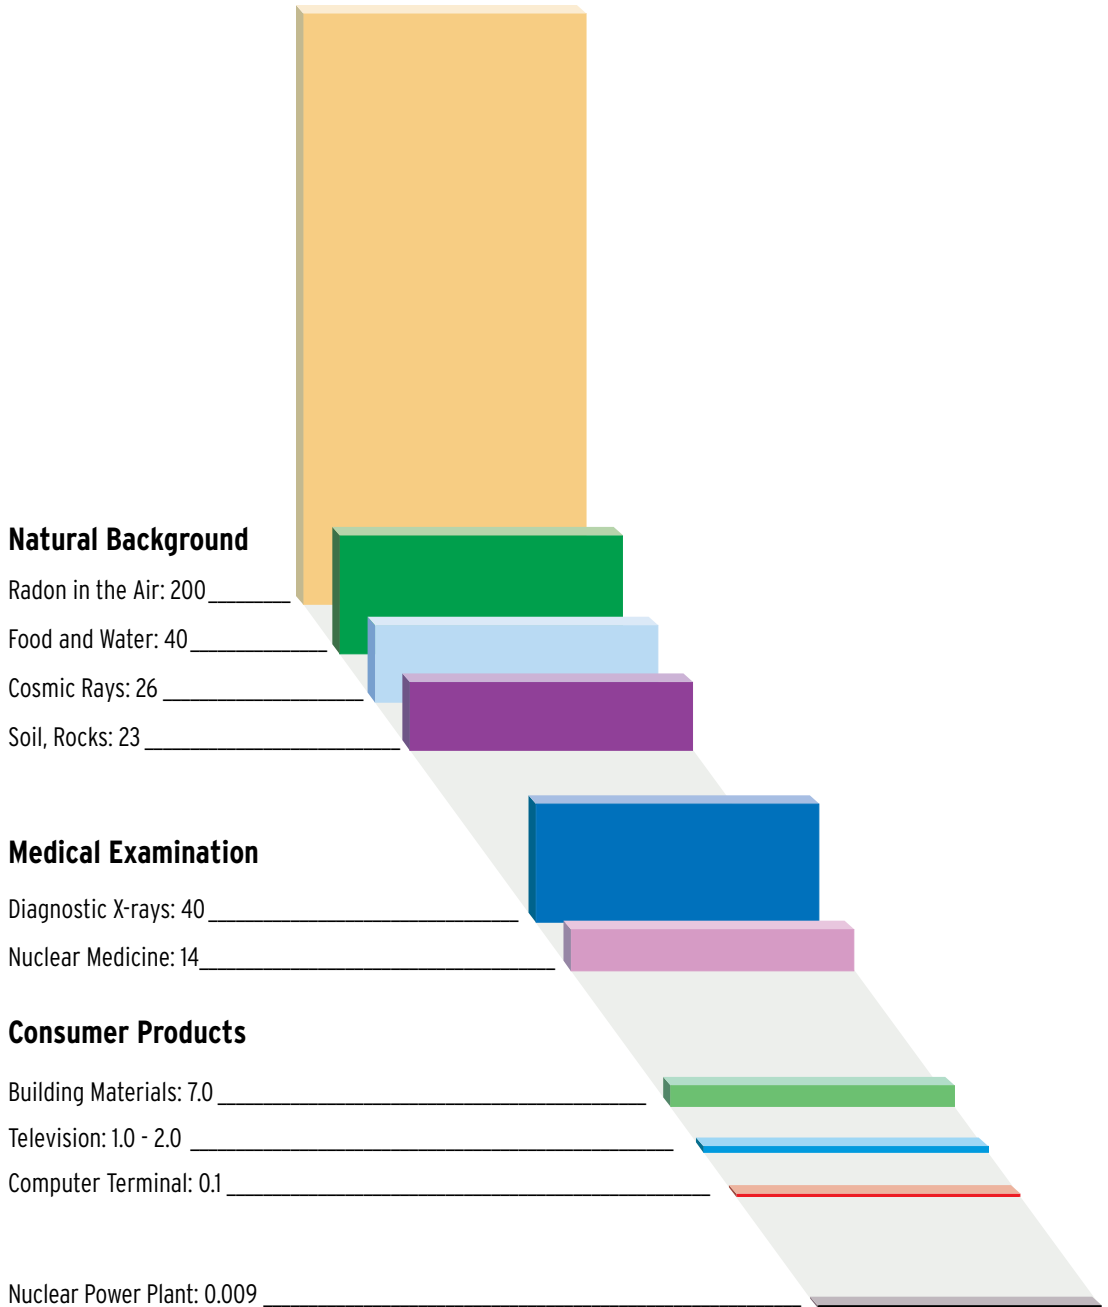

Source: *Understanding Radiation*, Nuclear Energy Institute

## Glossary

### **alert**

The second lowest of the four emergency classifications established by the Nuclear Regulatory Commission for nuclear power plants. An alert means events are in progress or have occurred that have substantially reduced or could substantially reduce plant safety. Any radioactive releases are expected to be below Environmental Protection Agency guidelines for protection of the public. No action by the general public is required.

### **alpha particles**

The heaviest and least penetrating form of ionizing radiation. They can be stopped by clothing or a sheet of paper.

### **atom**

The basic building block of elements. Atoms consist of a nucleus, orbited by particles with a negative electrical charge (electrons). Within the nucleus are particles that have a positive electrical charge (protons) and particles that have no electrical charge (neutrons).

### **background radiation**

Radiation that occurs naturally in the environment, such as radon gas from the ground, cosmic rays from space and radioactive elements in the human body.

### **beta particles**

Small, high-energy particles of ionizing radiation. They have enough energy to penetrate skin deeply enough to damage tissue, but can be stopped by a block of wood or thin sheet of metal.

### **cladding**

Metal tubing, made from a special alloy, which surrounds uranium fuel pellets.

### **condensate demineralizer**

A large filter vessel used to remove impurities from water before it is returned to the reactor. Each unit at Susquehanna has seven available.

### **condensate storage tank**

A 300,000-gallon tank that holds a reserve supply of reactor water for use during normal operations, refueling or emergencies. There is one tank for each unit at Susquehanna.

## **condenser**

A plant system that draws steam from the turbine and, by forcing it to pass over a series of tubes filled with water, cools the steam to water for reuse in the reactor.

## **containment**

Physical barriers to prevent or limit the release of radiation in the event of a serious accident. Primary containment is a massive steel-reinforced concrete structure. Secondary containment has steel-reinforced concrete walls and air pressure lower than outside air pressure to prevent air leaks.

## **contamination**

Radioactive material deposited on a non-radioactive surface.

## **control rods**

Stainless steel rods, shaped like the letter “x,” filled with a material (boron carbide and hafnium) that absorbs neutrons. These rods are inserted between the fuel assemblies to control or stop the nuclear reaction.

## **core**

The area inside the reactor vessel where the fuel is located and where the fission process takes place. Also refers to the fuel itself.

## **critical**

Term used to describe the nuclear reaction inside the reactor when it is self-sustaining.

## **curie**

Unit used to measure the amount of radioactivity in a substance.

## **decay**

The process by which an atom gives off energy, in the form of radioactive particles or waves, in order to reach a stable state.

## **defense in depth**

Concept used in the design of nuclear power plants to improve safety. It uses multiple protective barriers and multiple backup systems to prevent or limit the release of radiation.

## **emergency alert system**

Radio and television stations used by county emergency management officials to broadcast official information and instructions during an emergency.

## **emergency planning zone**

The geographic area within 10 miles of the Susquehanna plant that includes 27 municipalities in parts of Luzerne and Columbia counties. About 70,000 people live in this area.

## **enrichment**

The process by which the concentration of fissionable atoms in raw uranium is increased to about 4 percent from less than 1 percent so it can be used as power plant fuel.

## **fission**

The splitting of atoms into smaller parts, which results in a release of energy.

## **fuel assembly**

An arrangement of rods containing uranium fuel. Susquehanna fuel assemblies have 91 rods in a 10-by-10 array, with a central water channel equal to a 3-by-3 array. Each reactor contains 764 fuel assemblies.

## **fuel bundle**

See "fuel assembly."

## **fuel rod**

A 13.5-foot-long tube, made of a special metal alloy, that is used to hold uranium fuel pellets.

## **gamma rays**

Waves of ionizing radiation energetic enough to pass through a human body. It takes dense material, such as lead or several feet of concrete, to stop gamma rays.

## **general emergency**

The highest of four emergency classifications established by the Nuclear Regulatory Commission. A general emergency means events are imminent, are in progress or have occurred involving substantial damage to the reactor core and failures to plant safety systems that are needed for public protection. Radiation releases are expected to exceed Environmental Protection Agency guidelines for protection of the public beyond plant property. The public would be asked to tune into an Emergency Alert System radio or television station for official information and instructions.

## **half-life**

The time it takes for a radioactive substance to lose half of its radioactivity through decay. Each radioactive substance has a unique half-life.

## **low-level radioactive waste**

Material that becomes contaminated through use and contact with radioactive materials. At Susquehanna this includes filter materials, protective clothing, tools, rags and other solid wastes.

## **millirem**

The unit used to measure exposure to radiation.

## **moderator**

The substance used to slow neutrons released in the fissioning process to make them more likely to split other atoms.

## **neutrons**

Particles within the nucleus of an atom that have no electrical charge. In a nuclear power reactor, they sustain the reaction by splitting fissionable uranium atoms.

## **radiation**

Electromagnetic energy in the form of particles or waves. In a nuclear power plant, the particles or waves are emitted by unstable atoms undergoing decay.

## **reactor**

The large metal vessel where atoms are split to create the heat needed to boil water and produce steam that turns a turbine to generate electricity.

## **risk counties**

Counties that have residents who live within 10 miles of the power plant and who may be asked to take protective action in the event of an emergency at the plant. The risk counties for Susquehanna are Luzerne and Columbia.

## **scram**

The rapid shutdown of a nuclear power reactor by the insertion of all control rods into the core to stop fission. Control rods can insert automatically or at the direction of plant operators.

## **site area emergency**

The second highest of the four emergency classifications established by the Nuclear Regulatory Commission for nuclear power plants. A site area emergency means events are in progress or have occurred that have affected or are likely to affect major plant safety systems. Any radioactive releases are not expected to exceed Environmental Protection Agency guidelines for protection of the public beyond plant property. No action by the general public is required.

## **spent fuel**

Fuel that can no longer produce enough energy to support full-power operation of the plant. It is highly radioactive and requires special handling for safety.

## **spray pond**

An 8-acre, 25-million-gallon, man-made pond on Susquehanna plant property that serves as a source of cooling water for normal plant operations and emergencies. It holds enough water to meet all plant cooling needs for a minimum of 30 days.

## **suppression pool**

A source of nearly 1 million gallons of water for emergency cooling systems in the Susquehanna plant. There is a pool located beneath each reactor.

## **transformer**

A device used to increase or decrease the voltage of electricity.

## **unusual event**

The lowest of the four emergency classifications established by the Nuclear Regulatory Commission for nuclear power plants. An unusual event means a minor problem is in progress or has occurred that could reduce plant safety. No releases of radioactive material requiring off-site response or monitoring are expected. No action by the general public is required.

## **uranium**

The element used to fuel a nuclear power reactor. Uranium in nature consists mainly of two isotopes,  $U^{235}$  and  $U^{238}$ . The  $U^{235}$  atom readily reacts with neutrons and splits into new atoms.

## **Other Sources of Information**

### ***U.S. Nuclear Regulatory Commission***

Office of Public Affairs  
Washington, D.C. 20555  
301-415-8200  
[www.nrc.gov](http://www.nrc.gov)

### ***U.S. Nuclear Regulatory Commission***

Region I Office  
475 Allendale Road  
King of Prussia, PA 19406  
610-337-5000  
[www.nrc.gov/about-nrc/locations/region1.html](http://www.nrc.gov/about-nrc/locations/region1.html)

### ***Federal Emergency Management Agency***

Region III Office  
615 Chestnut St.  
Philadelphia, PA 19106  
215-931-5608  
[www.fema.gov](http://www.fema.gov)

### ***Pennsylvania Emergency Management Agency***

2605 Interstate Drive  
Harrisburg, PA 17110-9364  
717-651-2001  
[www.pema.state.pa.us](http://www.pema.state.pa.us)

### ***Pennsylvania Department of Environmental Protection***

Bureau of Radiation Protection  
P.O. Box 8469  
Harrisburg, PA 17105-8469  
717-787-2480  
[www.dep.state.pa.us](http://www.dep.state.pa.us)

### ***Luzerne County Emergency Management Agency***

185 Water St.  
Wilkes-Barre, PA 18711-1001  
570-820-4400  
[www.luzernecounty.org](http://www.luzernecounty.org)

### ***Columbia County Emergency Management Agency***

P.O. Box 380  
Bloomsburg, PA 17815  
570-389-5720  
[www.columbiacountyema.org](http://www.columbiacountyema.org)

### ***Nuclear Energy Institute***

Suite 400  
1776 I St. N.W.  
Washington, DC 20006  
202-739-8000  
[www.nei.org](http://www.nei.org)